# INDUSTRIAL + COMMERCIAL

Landis+Gyr Dialog

# ZMD400AT/CT, ZFD400AT/CT

# TECHNICAL DATA



# General

#### Voltage

Nominal Voltage U<sub>n</sub> ZMD400xT

3 x 58/100–69/120 V

3 x 110/190–133/230 V

3 x 220/380-240/415 V

extended operating voltage range

3 x 58/100-240/415 V

Nominal Voltage U<sub>n</sub> ZFD400xT

3 x 100-120 V

3 x 220-240 V

extended operating voltage range 3 x 100-415 V

Voltage Range 80–115% U<sub>n</sub>

## **Frequency**

Nominal Frequency  $f_n$  50 or 60 Hz tolerance  $\pm 2\%$ 

# **IEC-specific data**

#### Current

Nominal Current  $I_n$  1 A, 2 A, 5 A, 5||1 A

Short Circuit Current 0.5 s with 20 x I<sub>max</sub>

# **Measurement Accuracy**

Accuracy ZxD405xT

active energy to IEC 62053-22 class 0.5 S
reactive energy to IEC 62053-23 class 1

Accuracy ZxD410xT

active energy to IEC 62053-21 class 1 reactive energy to IEC 62053-23 class 1

#### **Measurement Behaviour**

 $\begin{array}{cccc} \text{Starting Current ZxD405xT} \\ \text{according to IEC} & 0.1\% \ I_n \\ \text{typical} & 0.07\% \ I_n \\ 5||1 \ A & \text{as 1 A meter} \end{array}$ 

Starting Current ZxD410xT

 $\begin{array}{lll} \text{according to IEC} & 0.2\% \ I_n \\ \text{typical} & 0.14\% \ I_n \\ 5||1 \ A & \text{as 1 A meter} \end{array}$ 

The startup of the meter is controlled by the starting power and not by the starting current.

Starting Power in M-Circuit single phase nominal power x starting current

Starting Power in F-Circuit all phases nominal voltage /  $\sqrt{3}$  x starting current x 3

# MID-specific data

# **Current (for Classes B and C)**

•	•
Rated Current I <sub>n</sub>	1.0, 5.0 A
Minimum Current I <sub>min</sub>	0.01, 0.05 A
Transitional Current I <sub>tr</sub>	0.05, 0.25 A
Maximum Current I <sub>max</sub>	2.0, 10.0 A

# **Measurement Accuracy**

ZxD400xT; to EN 50470-3 Classes B and C

#### **Measurement Behaviour**

Starting Current I <sub>st</sub>	
Class B: I <sub>st</sub>	0.002, 0.01 A
Class C: I <sub>st</sub>	0.001, 0.005 A

## General

# **Operating Behaviour**

Voltage Interruption (Power Down)		
bridging time according to IEC	0.5 s	
data storage	after another 0.2 s	
switch off	after approx. 2.5 s	

Voltage Restoration (Power Up)	
function standby 3 phases	after 2 s
function standby 1 phase	after 5 s
detection of	
energy direction + phase voltage	after 2 to 3 s

## **Power Consumption**

Power Consumption per	Phase in the	Voltage	Circuit
phase voltage	58 V	110 V	240 V
active power (typical)	0.65 W	0.7 W	0.8 W
apparent power (typical)	1.3 VA	1.7 VA	3.6 VA

Power Consumption per Phase in the Current Circuit phase current 1 A 5 A 10 A active power (typical) 5 mW 0.125 W 0.5 W apparent power (typical) 5 mVA 0.125 VA 0.5 VA

## **Environmental Influences**

Temperatur Range	to IEC 62052-11
operation	−25 °C to +70 °C
storage	–40 °C to +85 °C
Temperature Coefficent	
range	from -25 °C to +70 °C

average value (typical)	± 0.012% per K
at $\cos \varphi = 1$ (from 0.05 lb to $I_{max}$ )	± 0.02% per K
at $cos\phi = 0.5$ (from 0.1 lb to $I_{max}$ )	± 0.03% per K

Impermeability according to IEC 60529 IP51

# **Electromagnetic Compatibility**

Electrostatic Discharges	to IEC 61000-4-2
contact discharge	15 kV
Electromagnetic RF Fields	to IEC 61000-4-3
80 MHz – 2 GHz	10 and 30 V/m

Radio Interference Suppression	
according to IEC/CISPR 22	class B

Fast Transient Burst Test	to IEC 61000-4-4
current and voltage circuits not un	nder load 4 kV
current and voltage circuits under	load
according to IEC 62053-21/22/23	2 kV
auxiliary circuits > 40 V	1 kV

Fast Transient Surge Test	to IEC 61000-4-5
current and voltage circuits	4 kV
auxiliary circuits > 40 V	1 kV

# **Insulation Strenght**

Insulation Strenght	4 kV @ 50 Hz during 1	min
modulation officing it	TRV @ JOTIZ during i	

Impulse Voltage 1.2/50μs	to IEC 62052-11
current and voltage circuits	8 kV
auxiliary circuits	6 kV
Protection Class II according to IE	EC 62052-11

#### **Calendar Clock**

Calendar Type	Gregorian or Persian (Jalaali)
-	·

< 5 ppm

Backup Time (Power Reserve)	
with supercap	> 20 days
loading time for max. backup time	300 h
with battery (optional)	10 years
battery type	CR-P2

#### Display

Accuracy

<i>j</i>		
Characteristics		
type	LCD liquid crys	tal display
digit size in value field		8 mm
number of positions in v	alue field	up to 8
digit size in index field		6 mm
number of positions in in	ndex field	up to 8

## **Inputs and Outputs**

Control Inputs

control voltage Us 100–240 V AC input current < 2 mA ohmic at 230 V AC

**Output Contacts** 

type solid state relay voltage 12–240 V AC/DC max. current 100 mA max. pulse frequency (pulse length 20 ms) 25 Hz

Optical Test Output Active and Reactive Energy type red LED number 2 meter constant selectable

#### **Communication Interfaces**

Optical Interface according to IEC 62056-21 type serial, bidirectional, half duplex max. bit rate 9600 bps protocols IEC 62056-21 and dlms

**Communication Units** 

Exchangeable communciation units for various applications.

# **Additional Power Supply (optional)**

On Extension Board 045x
nominal voltage range
tolerance
frequency
max. power consumption

100–240 V AC/DC
80–115% U<sub>n</sub>
50 or 60 Hz

On Extension Board 046x

 $\begin{array}{ll} \text{nominal voltage range} & 12\text{--}24 \text{ VDC} \\ \text{tolerance} & 80\text{--}115\% \text{ U}_{\text{n}} \\ \text{max. power consumption} & 3.5 \text{ W} \\ \end{array}$ 

## Ripple Control Receiver (optional)

On Extension Board 043x or 003x (ZMD400 only)

Same functionality as RCR161.

All established RCR systems e.g. Semagyr, Ricontic, Decabit, Double Decabit, K22/Z22 are supported. Code length, pulse length and pulse position can be parameterised.

**Electrical Data** 

nominal voltage 58 or 230 V frequency 50 or 60 Hz

Filter Values (parameterisable)

 $\begin{array}{ll} \text{functional voltage } U_f & 0.3\text{--}2.5\% \ U_n \\ \text{control frequency } f_s & 110\text{--}2000 \ \text{Hz} \\ \text{bandwidth} & 0.6\text{--}6\% \ f_s \end{array}$ 

## Weight and Dimensions

Weight approx. 1.5 kg

**External Dimensions** 

width 177 mm
height (with short terminal cover) 244 mm
height (with standard terminal cover) 281.5 mm
height (with extended hook) 305.5 mm
depth 75 mm

Suspension Triangle

height (with extended hook)

height (suspension eyelet open)

height (suspension eyelet covered)

width

230 mm

206 mm

190 mm

150 mm

**Terminal Cover** 

short no free space
standard 40 mm free space
long 60 mm free space
GSM 60 mm free space
ZxB-type 80 mm 80 mm free space
ZxB-type 110 mm 110 mm free space
ADP1 adapter
RCR/FTY adapter

#### Material

#### Housing

The meter housing is made of polycarbonate which is partly glass-fibre reinforced.


#### Connections

**Phase Connections** 


type screw type terminals diameter 5.2 mm recommended conductor cross section 4–6 mm $^2$  screw head Pozidrive Kombi No. 2 screw dimensions M4 x 8 screw head diameter  $\leq 5.8$  mm tightening torque < 1.7 Nm

#### Other Connections


type screwless spring-type terminal max. current of voltage outputs 1 A max. voltage of inputs 250 V

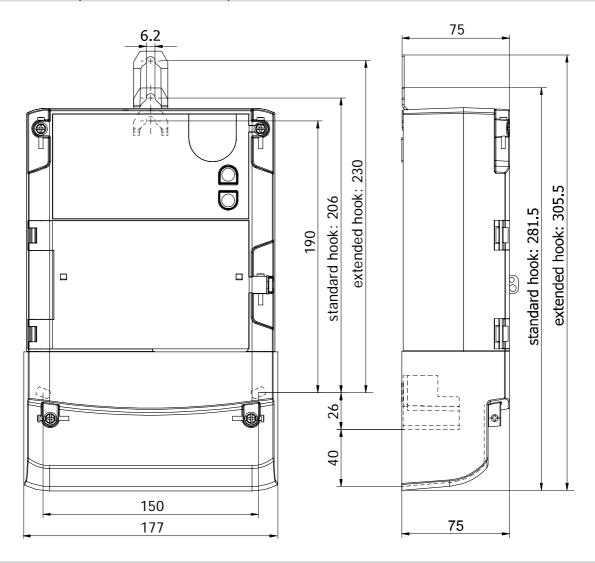


## **Terminal Dimensions**

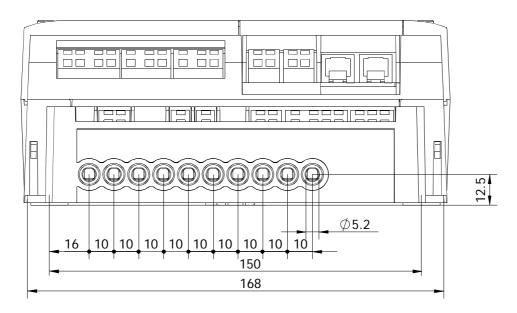


## Terminal Layout according to DIN

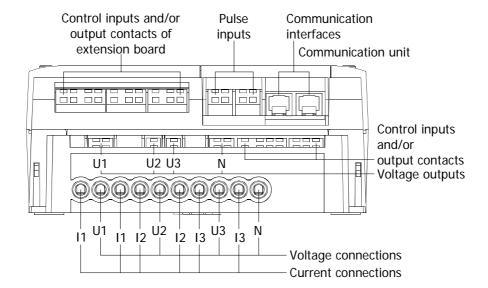

## Symmetrical Terminal Layout (optional, ZMD400 only)

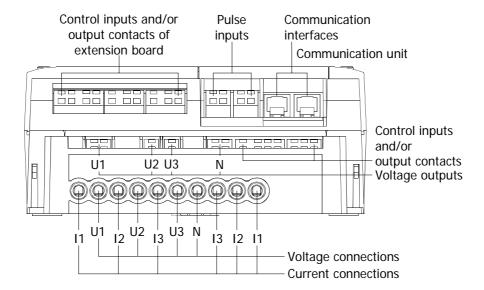

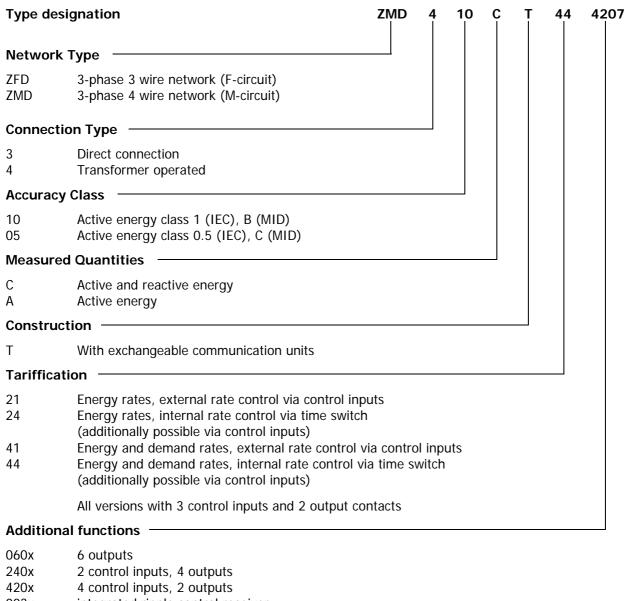

UUUX	o outputs
240x	2 control inputs, 4 outputs
420x	4 control inputs, 2 outputs
003x	integrated ripple control receiver
043x	4 outputs, integrated ripple control receiver
045x	4 outputs, additional power supply 100–240 V AC/DC
046x	4 outputs, additional power supply 12–24 V DC
0xxx	no additional functions
xxx2	DC-magnet-detection
xxx7	load profile
xxx9	DC-magnet-detection and load profile

Subject to change without notice.

 ${\bf Landis+Gyr\ Ltd}.$ 

Feldstrasse 1 CH-6301 Zug Switzerland

Phone: +41 41 935 6000 www.landisgyr.com

